


aneesah akram pure compound 1  
P31CPD CDC13 /opt/data Adv\_Exp 40

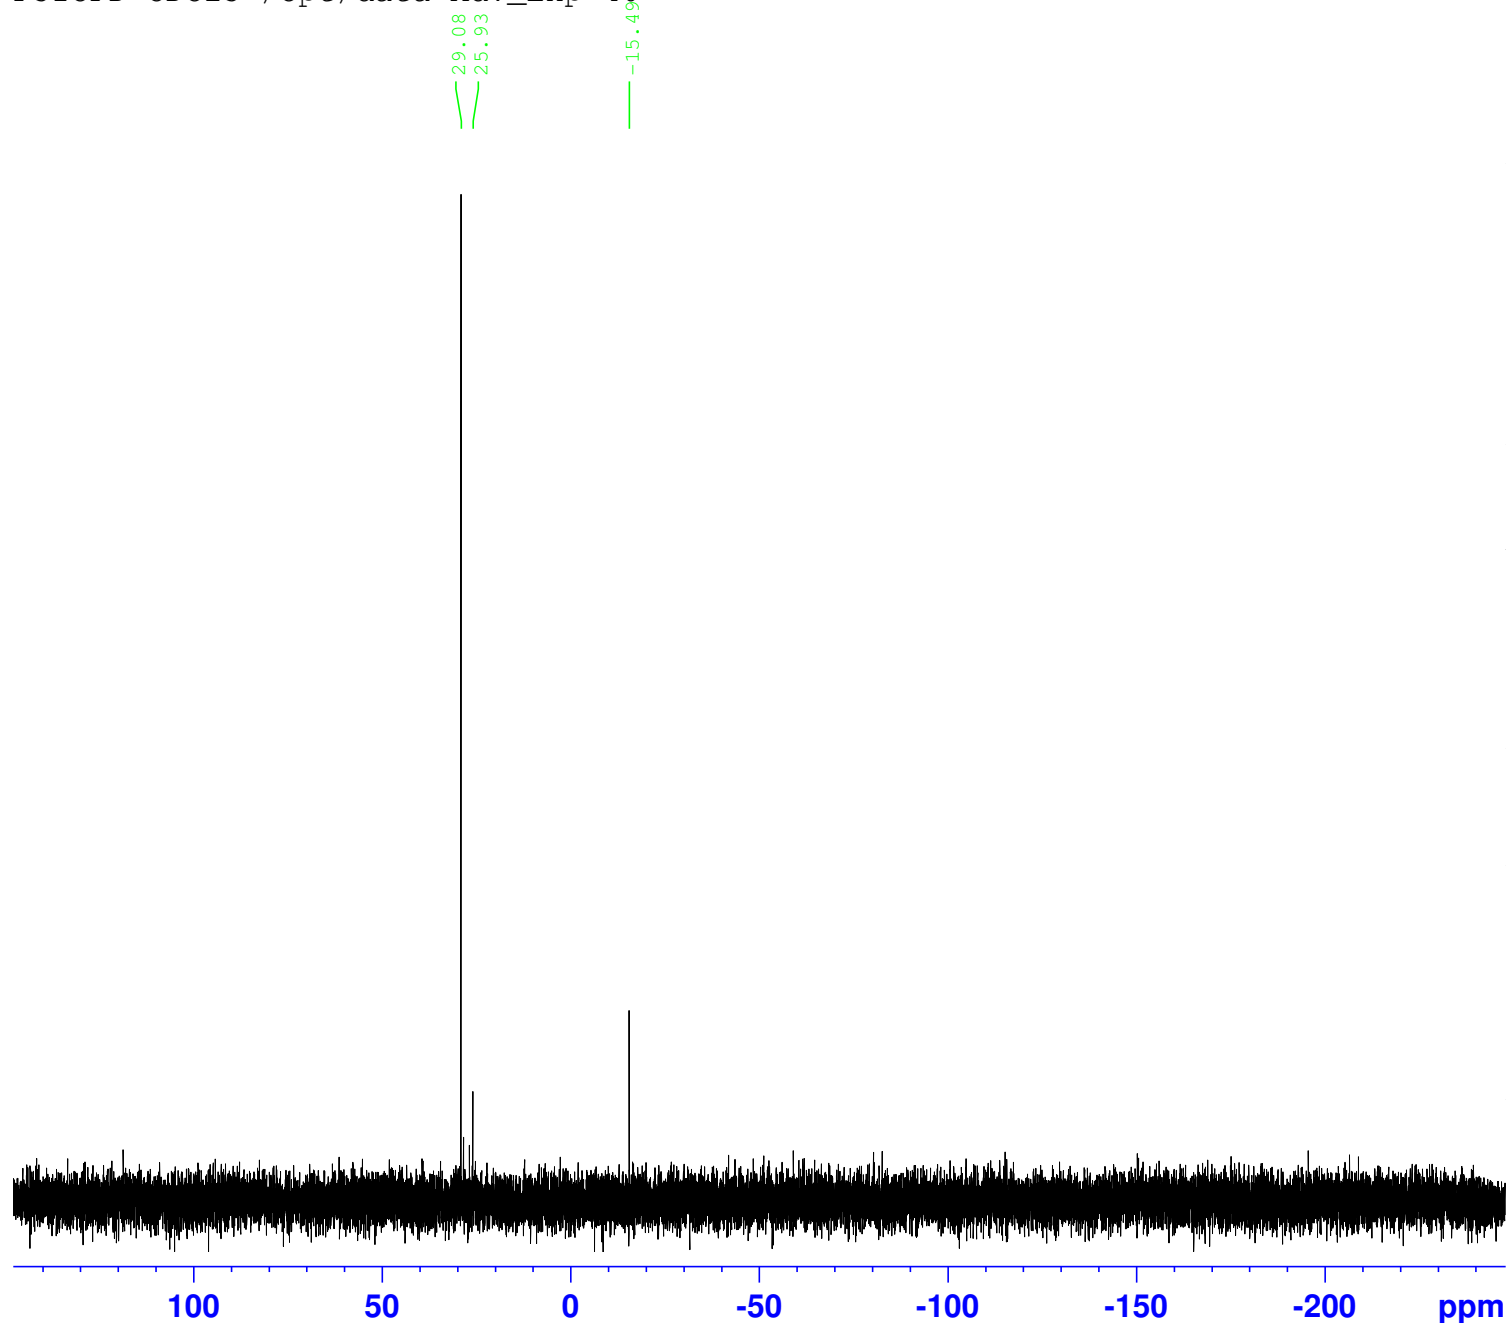

Current Data Parameters  
NAME X\_20180921  
EXPNO 12  
PROCNO 1

F2 - Acquisition Parameters  
Date\_ 20180921  
Time 10.14 h  
INSTRUM spect  
PROBHD Z824801\_0046 (  
PULPROG zgpg30  
TD 65536  
SOLVENT CDCl3  
NS 16  
DS 4  
SWH 64102.562 Hz  
FIDRES 1.956255 Hz  
AQ 0.5111808 sec  
RG 200.25  
DW 7.800 usec  
DE 6.50 usec  
TE 300.0 K  
D1 2.00000000 sec  
D11 0.03000000 sec  
TD0 1  
SFO1 162.0079729 MHz  
NUC1 31P  
P0 2.67 usec  
P1 8.00 usec  
PLW1 36.45100021 W  
SFO2 400.2316009 MHz  
NUC2 1H  
CPDPRG[2] waltz16  
PCPD2 90.00 usec  
PLW2 20.00000000 W  
PLW12 0.23714000 W  
PLW13 0.11928000 W

F2 - Processing parameters  
SI 32768  
SF 162.0160737 MHz  
WDW EM  
SSB 0  
LB 1.00 Hz  
GB 0  
PC 1.40

0.39  
0.71  
0.83  
0.96  
3.23  
5.19  
1.56  
4.37  
1.52  
0.73  
2.61  
0.26  
0.70  
1.05  
3.16  
0.32  
0.33  
1.23  
1.41  
0.69  
0.48  
1.08  
0.91  
0.75  
0.27  
0.87  
1.28  
1.90  
0.70  
1.23  
2.40  
1.00  
1.58  
1.08  
0.96  
0.87  
0.76  
1.51  
1.45  
0.53  
0.07  
0.47  
0.61  
1.14  
0.70  
0.80