


PRK 1P RECRYSTALLISED COMPOUND 1
P31CPD CDC13 /opt/data Adv_Exp 43

29.00
21.98
21.70

Current Data Parameters
NAME X_20181108
EXPNO 132
PROCNO 1

F2 - Acquisition Parameters
Date_ 20181109
Time 11.55 h
INSTRUM spect
PROBHD Z824801_0046 (
PULPROG zgpg30
TD 65536
SOLVENT CDC13
NS 16
DS 4
SWH 64102.562 Hz
FIDRES 1.956255 Hz
AQ 0.5111808 sec
RG 200.25
DW 7.800 usec
DE 6.50 usec
TE 300.0 K
D1 2.00000000 sec
D11 0.03000000 sec
TD0 1
SFO1 162.0079729 MHz
NUC1 31P
P0 2.67 usec
P1 8.00 usec
PLW1 36.45100021 W
SFO2 400.2316009 MHz
NUC2 1H
CPDPRG[2] waltz16
PCPD2 90.00 usec
PLW2 20.00000000 W
PLW12 0.23714000 W
PLW13 0.11928000 W

F2 - Processing parameters
SI 32768
SF 162.0160737 MHz
WDW EM
SSB 0
LB 1.00 Hz
GB 0
PC 1.40

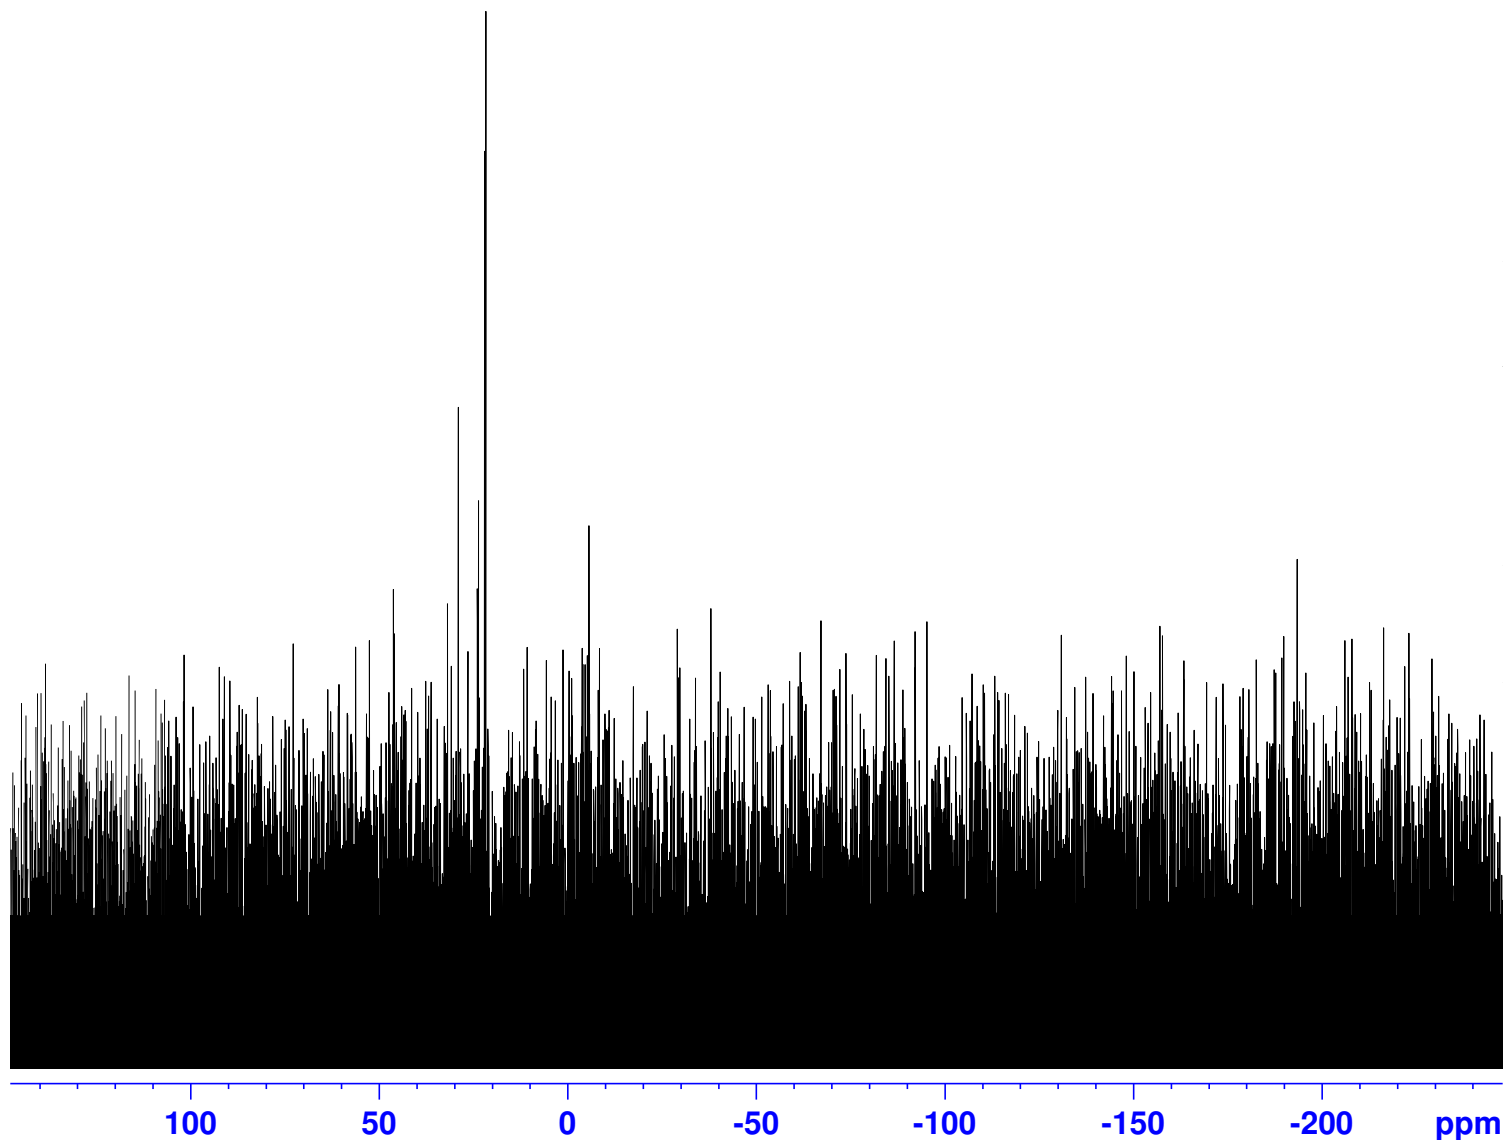

0.03
0.89
1.42
0.49
4.03
2.10
8.44
1.61
2.62
0.83
1.25
1.51
1.37
0.42
0.29
3.34
1.23
0.19
0.62
1.15
0.13
0.44
0.68
1.25
0.60
1.80
1.32
0.46
1.36
0.66
0.55
1.58
1.04
0.05
1.74
0.07
0.98
0.73
0.67
0.74
0.77
0.59
0.26
0.60
2.05