


NRK 01 P1
C13CPD128 DMSO /opt/data Adv Exp 23



167.39
161.62
144.78
137.07
137.04
136.92
132.53
131.29
131.24
131.22
131.18
130.97
130.58
127.08
115.54
114.82
113.97

55.76
51.73
40.60
40.39
40.19
39.98
39.77
39.56
39.35

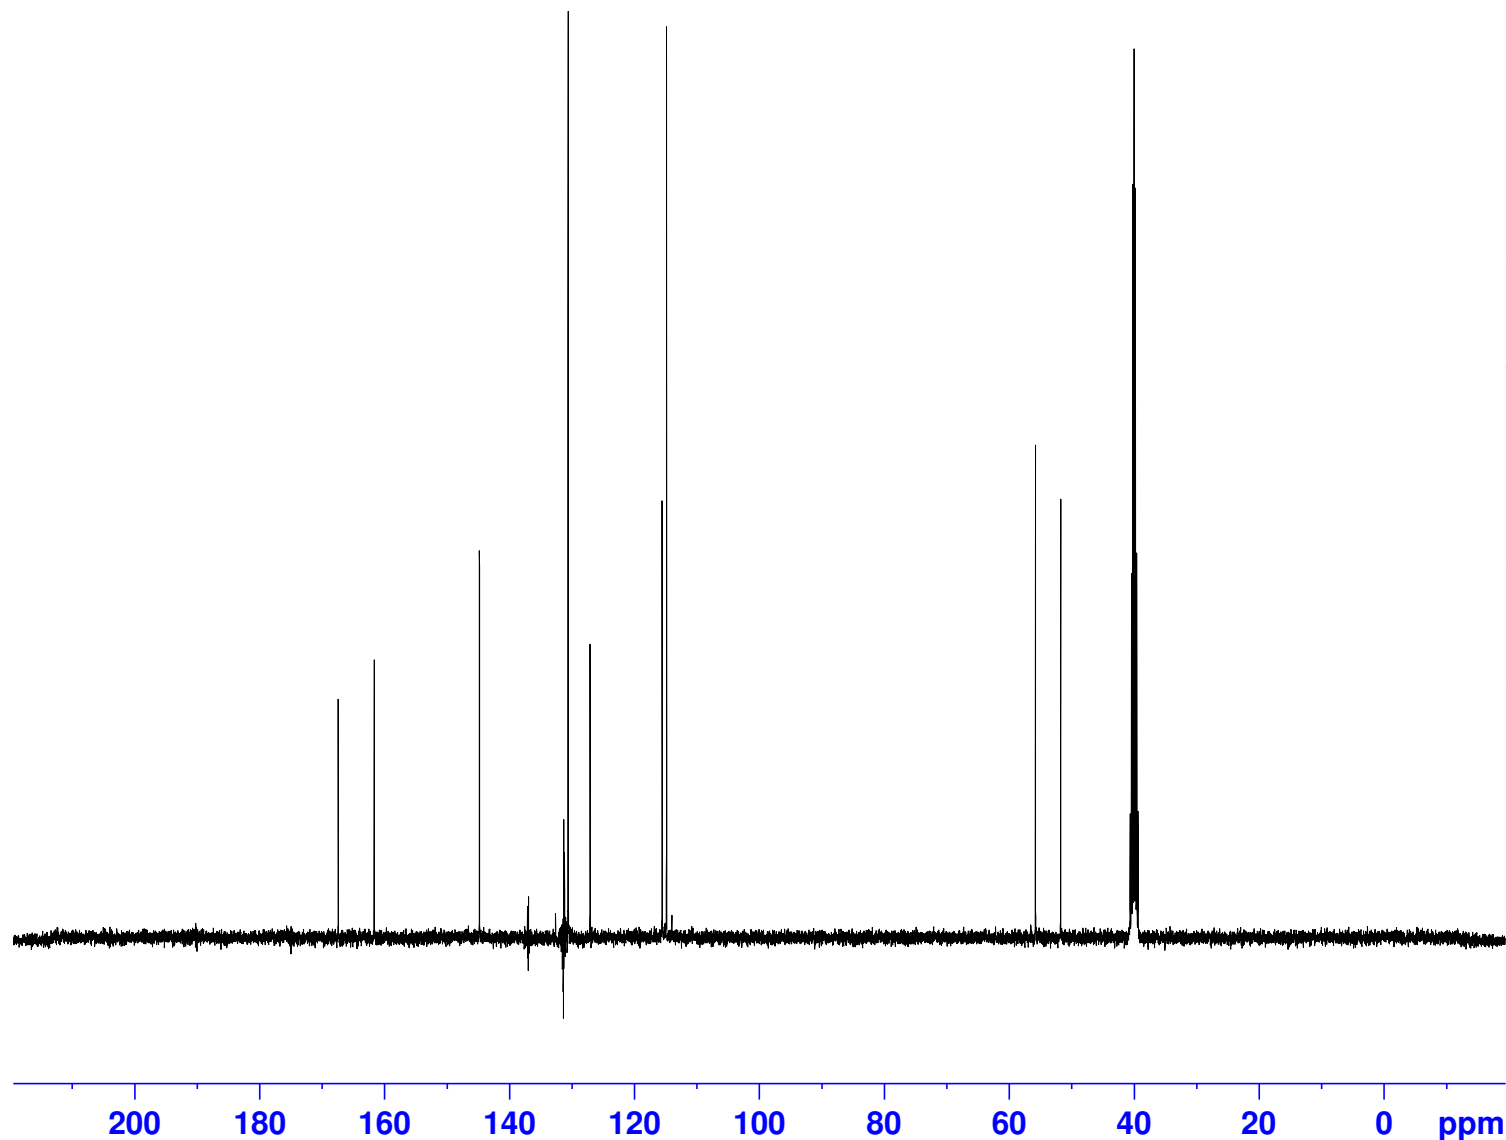

Current Data Parameters
NAME X_20221021
EXPNO 131
PROCNO 1

F2 - Acquisition Parameters
Date_ 20221021
Time 18.52 h
INSTRUM spect
PROBHD Z824801_0046 (
PULPROG zgpg30
TD 65536
SOLVENT DMSO
NS 128
DS 4
SWH 24038.461 Hz
FIDRES 0.733596 Hz
AQ 1.3631488 sec
RG 200.25
DW 20.800 usec
DE 6.50 usec
TE 300.0 K
D1 2.00000000 sec
D11 0.03000000 sec
TD0 1
SFO1 100.6479773 MHz
NUC1 13C
P0 3.33 usec
P1 10.00 usec
PLW1 48.00000000 W
SFO2 400.2316009 MHz
NUC2 1H
CPDPRG[2] waltz65
PCPD2 90.00 usec
PLW2 20.00000000 W
PLW12 0.23714000 W
PLW13 0.11928000 W

F2 - Processing parameters
SI 32768
SF 100.6379135 MHz
WDW EM
SSB 0
LB 1.00 Hz
GB 0
PC 1.40